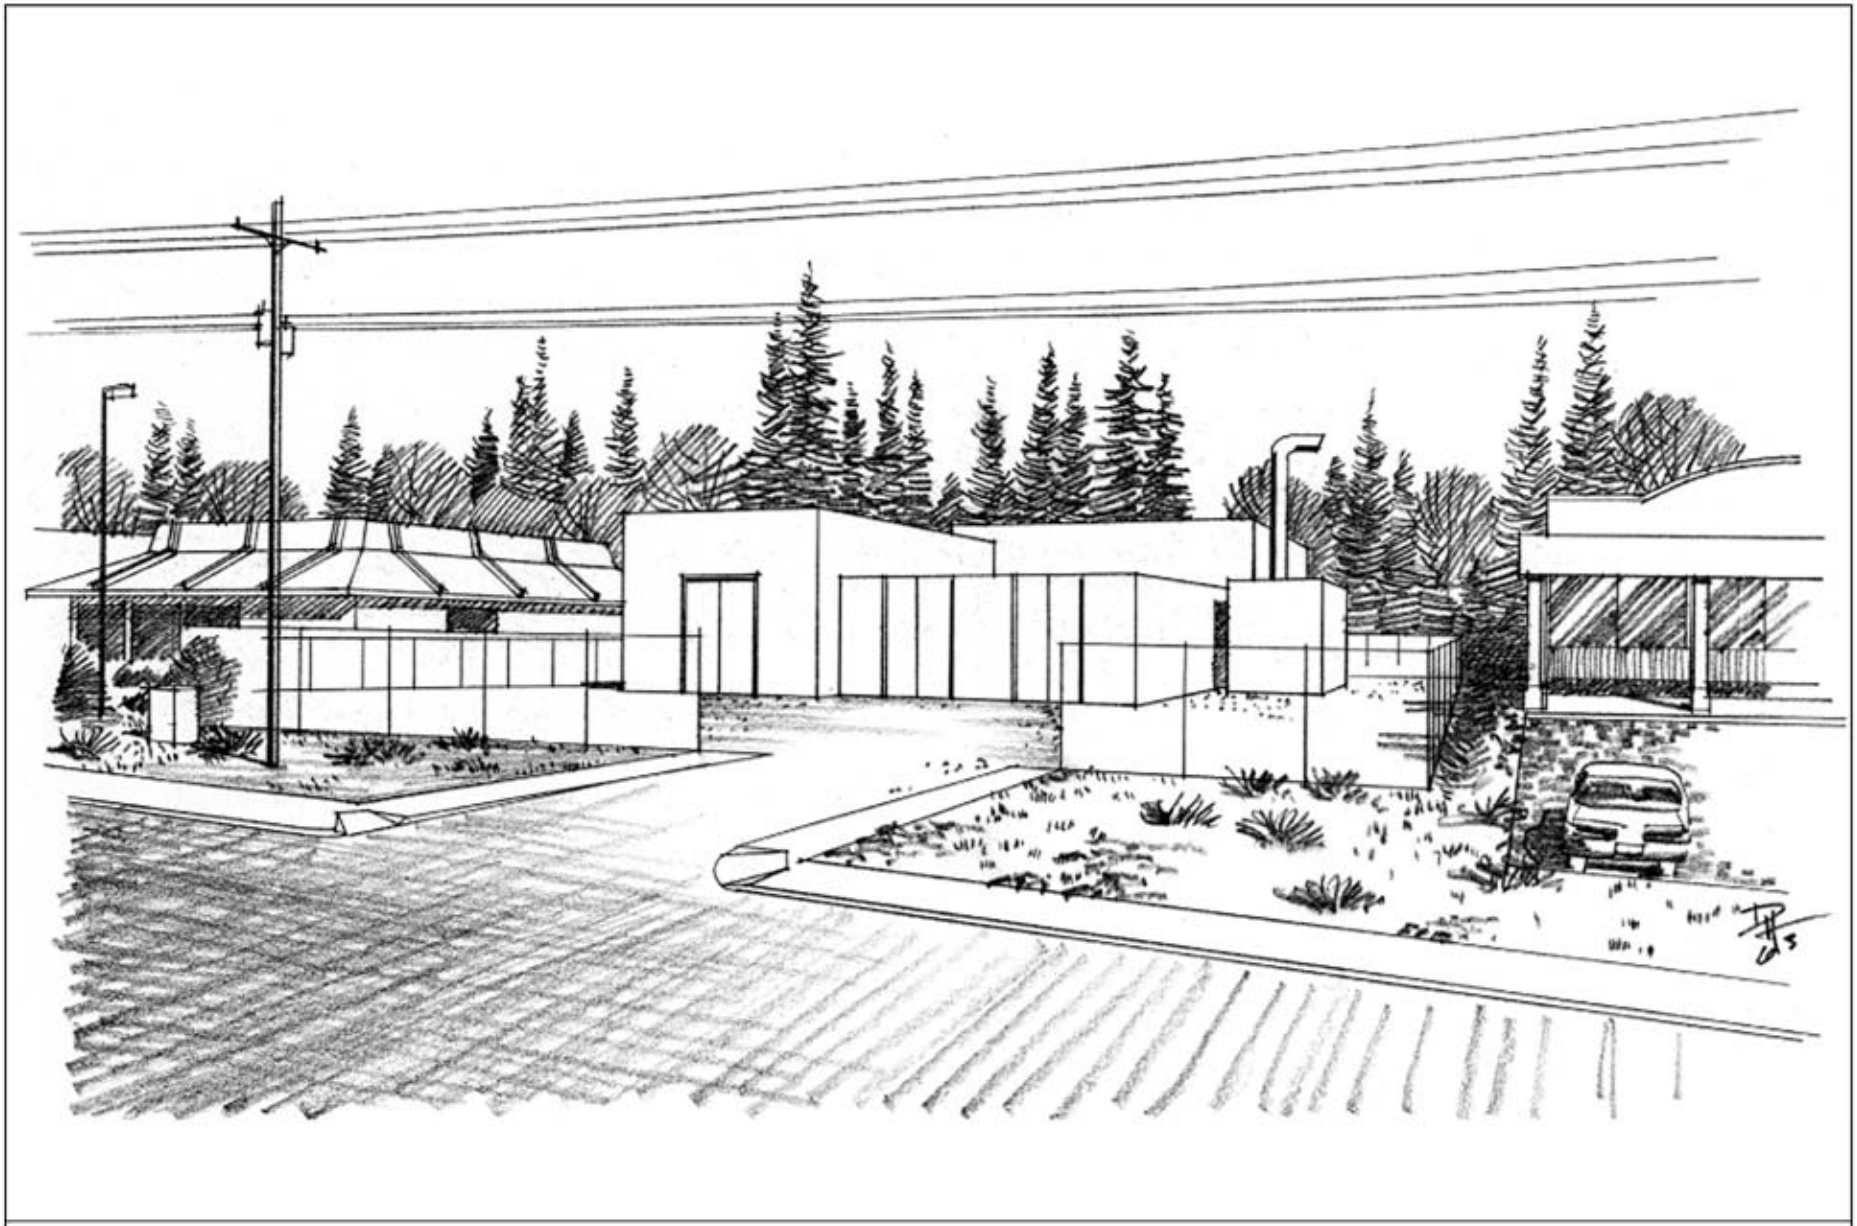

Figure 12-20

Potential Impact of Odor Control and Dechlorination Facilities in Commercial Strip Aesthetic Setting

File Name: FIG_12-20.pdf

BRIGHTWATER FINAL EIS