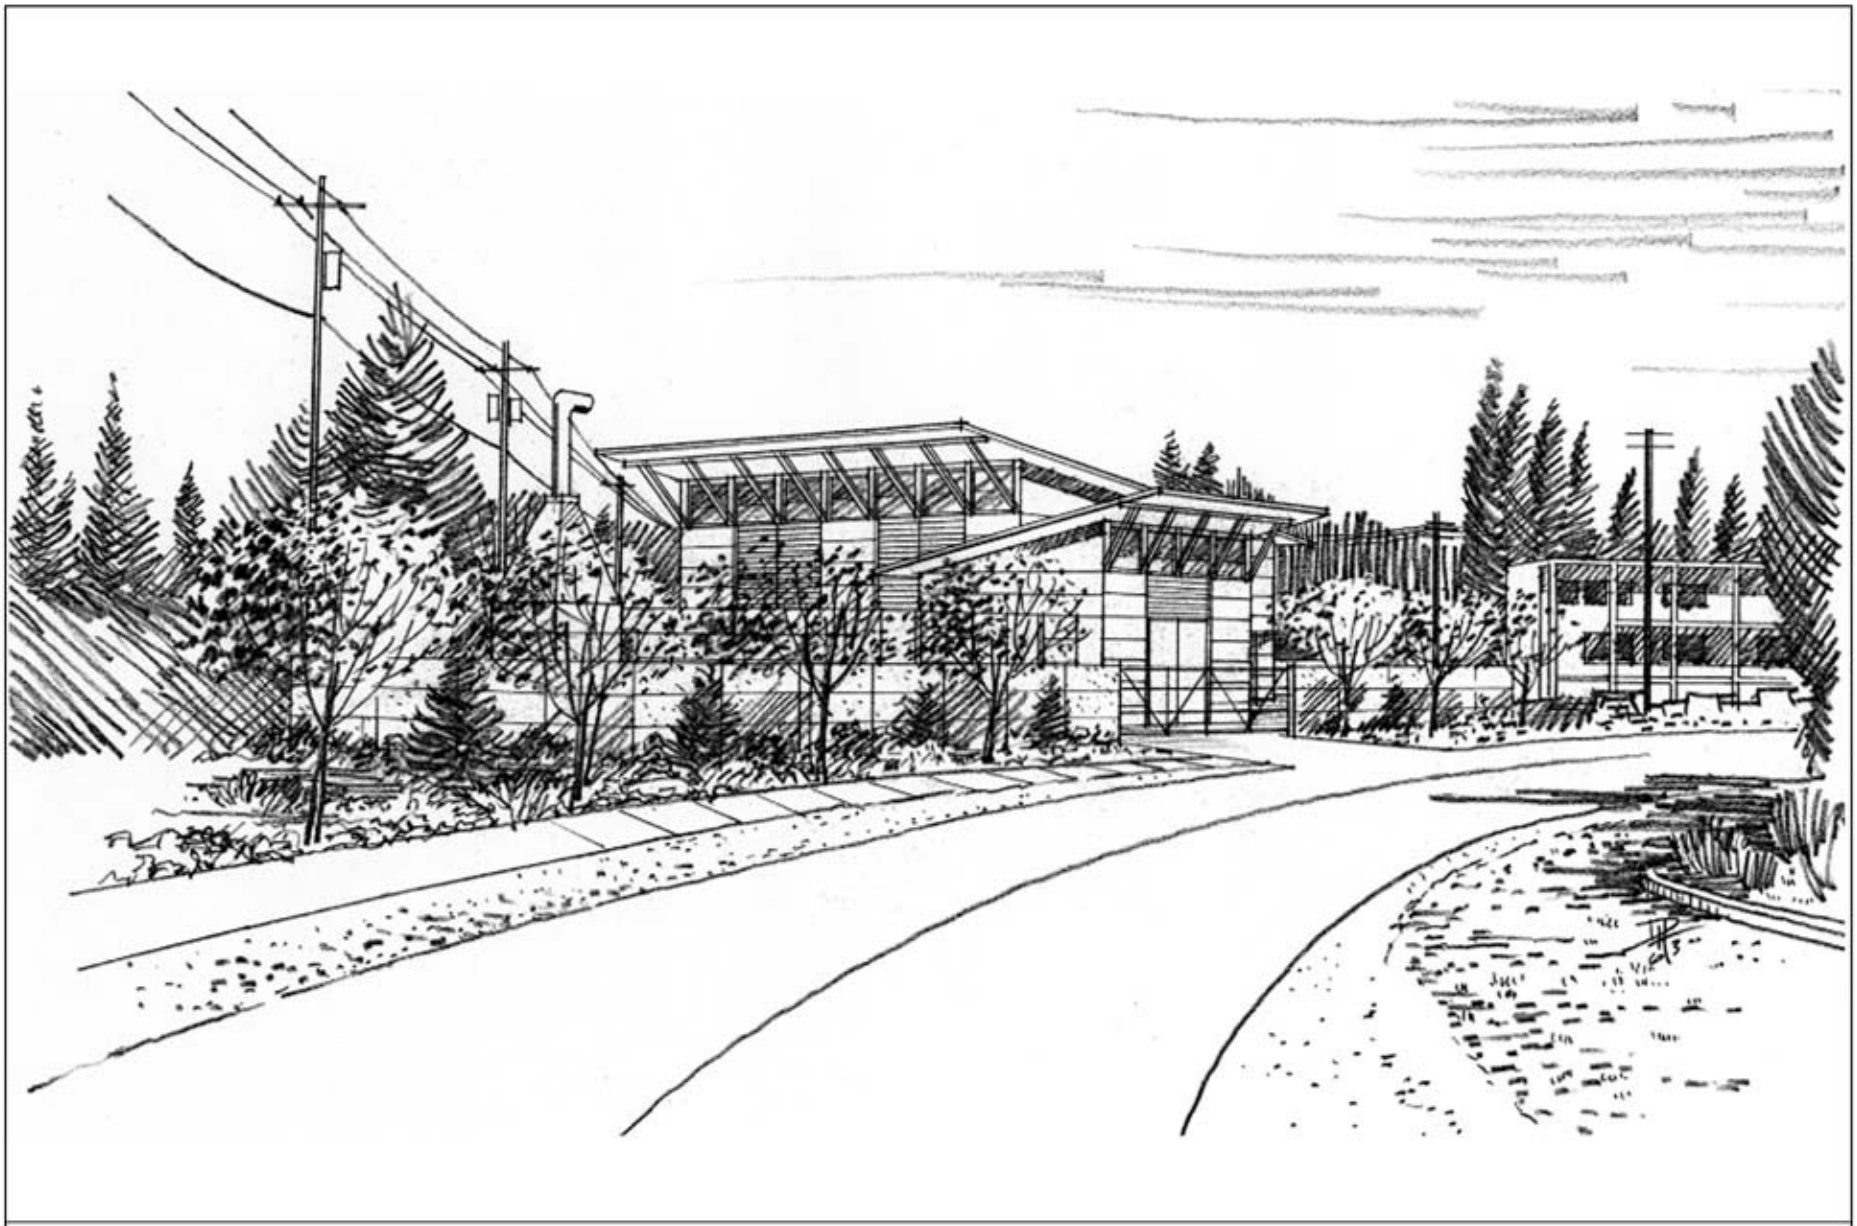

Figure 12-27

Mitigated Odor Control Facility and Pump Station in Industrial Aesthetic Setting

File Name: FIG_12-27.pdf

BRIGHTWATER FINAL EIS