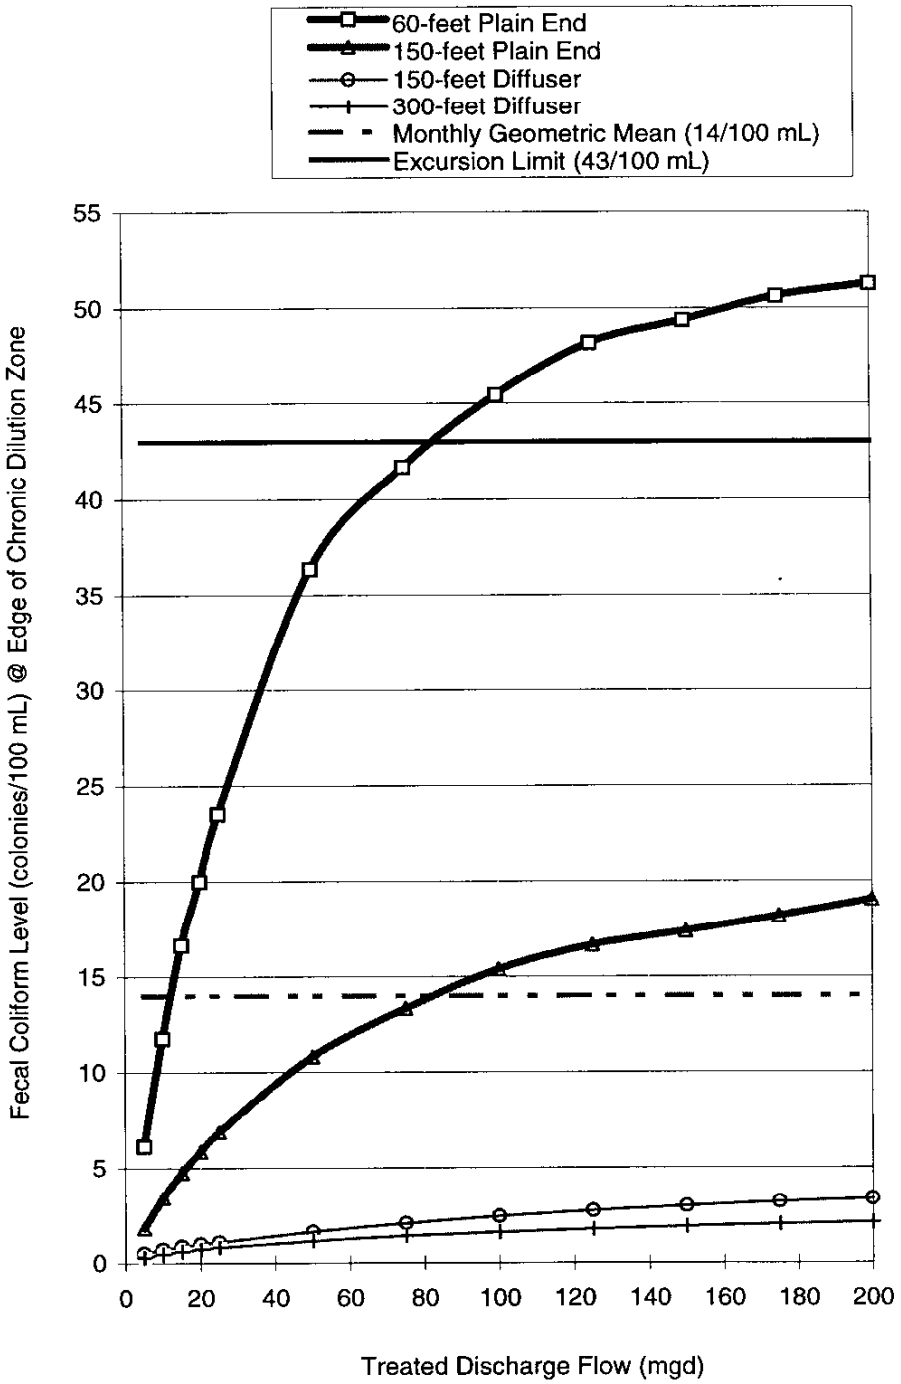

Figure 6-4. Treated Outfall Discharge Flow (mgd) Assuming "End of Pipe" Fecal Coliform Level of 400/100 mL