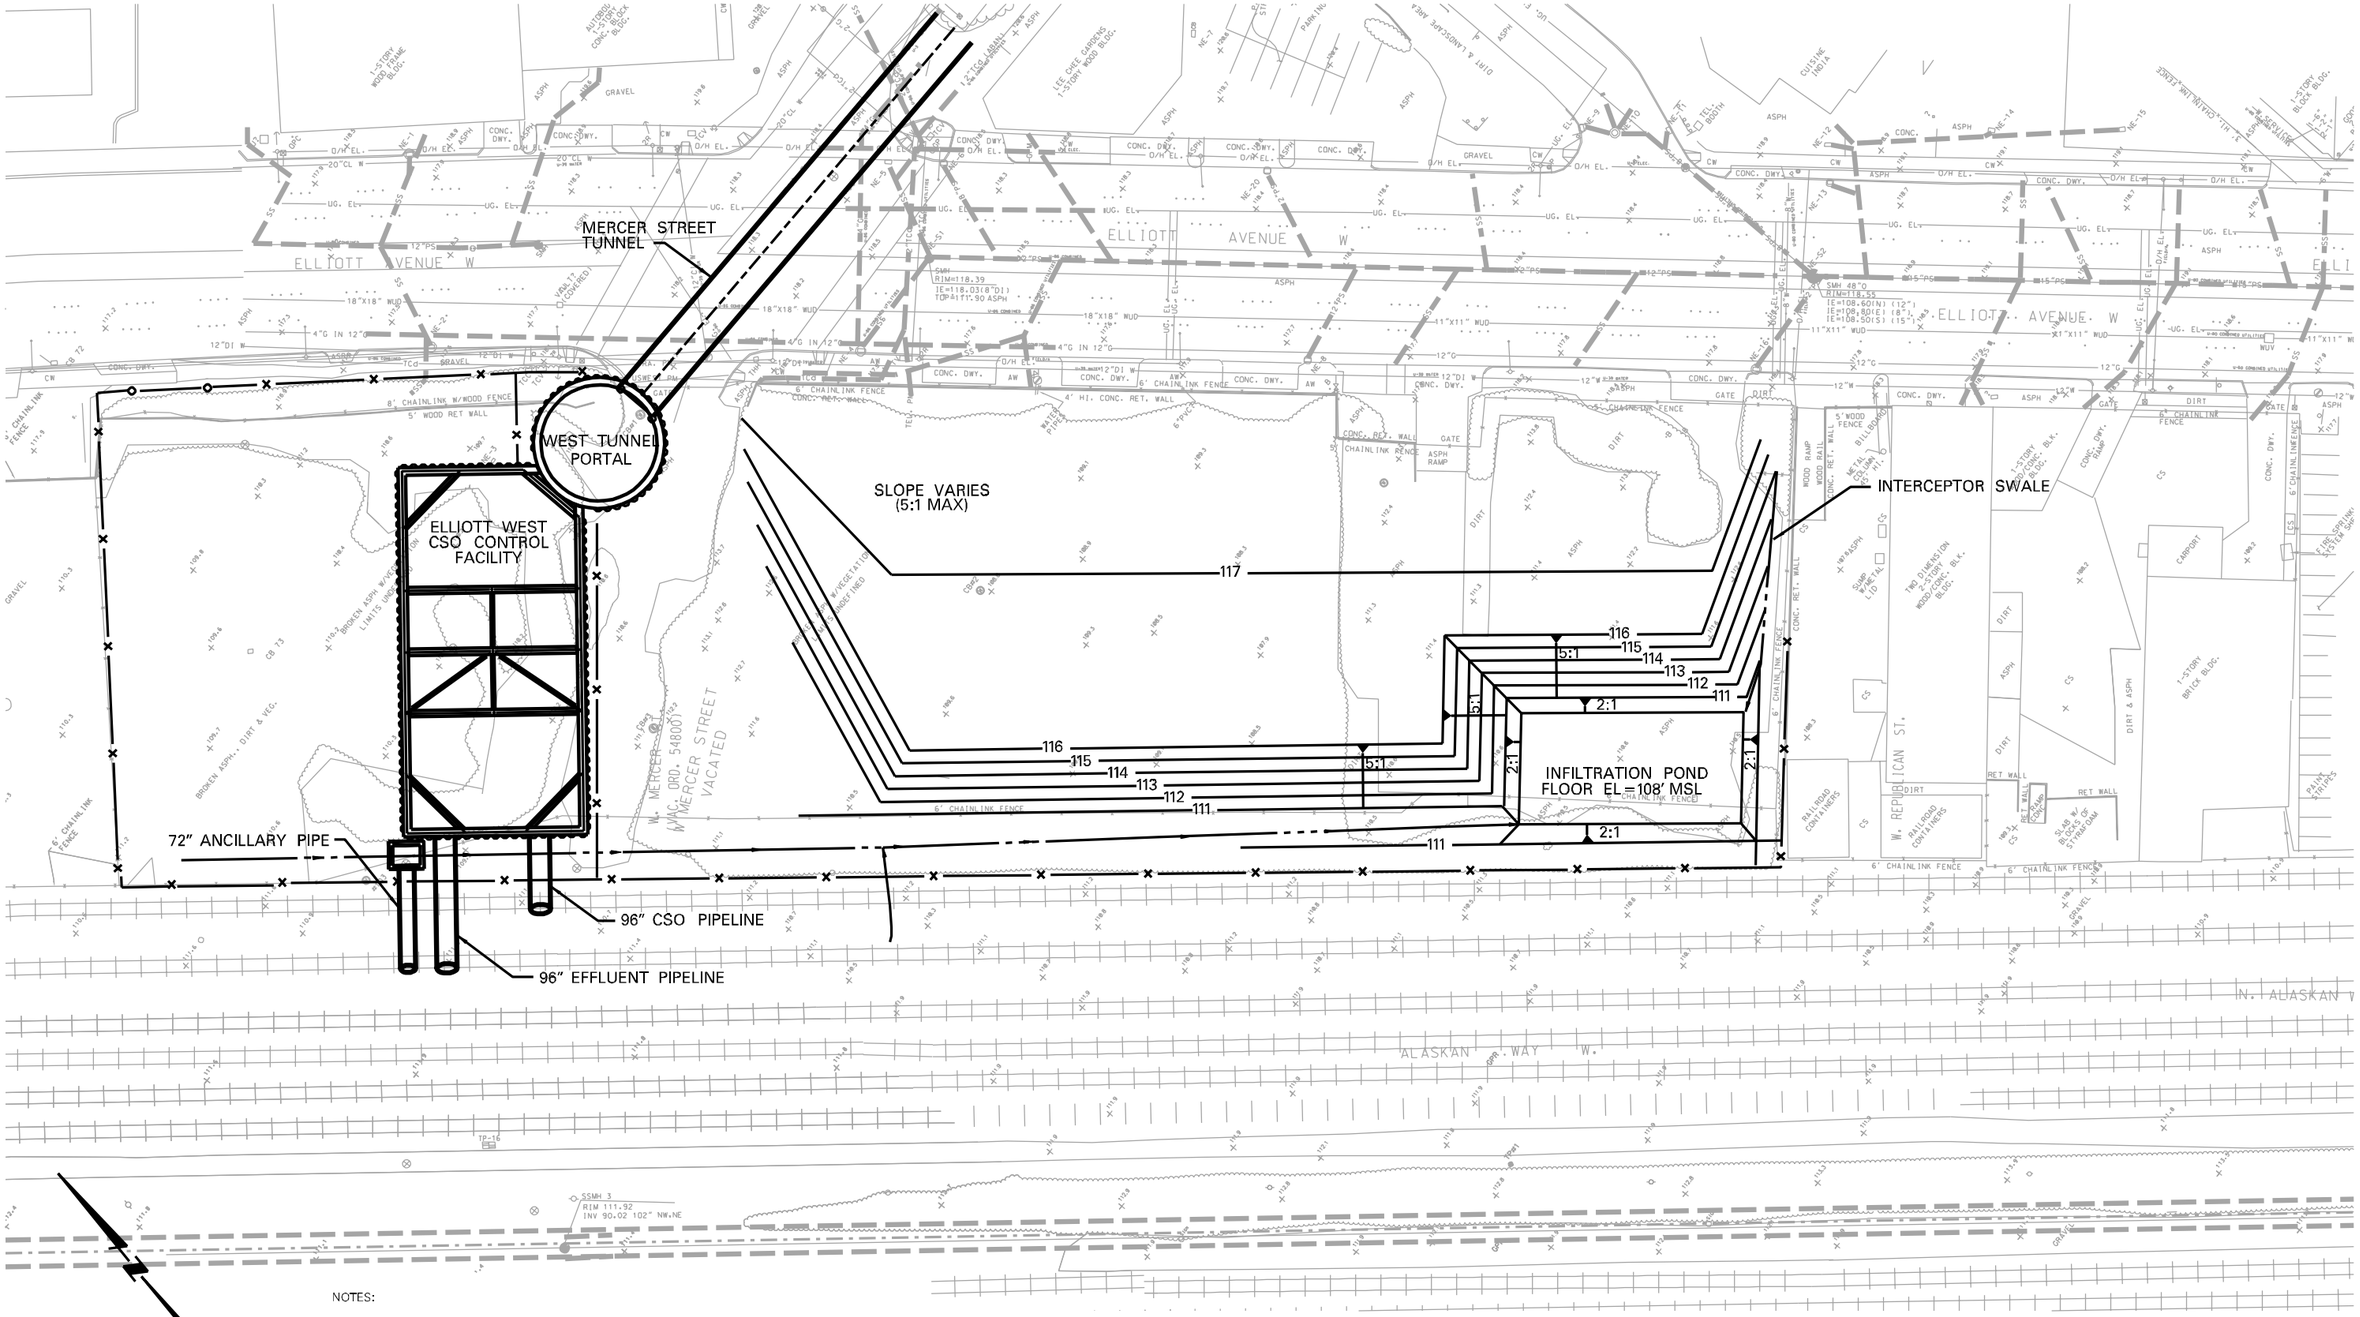

30 0 30 60

SCALE: 1" = 60'

NOTES:

THE ELLIOTT WEST CSO CONTROL FACILITY WILL PROVIDE FLOATABLE MATERIAL CONTROL, DISINFECTION AND DECHLORINATION. DURING DISCHARGE EVENTS, WASTEWATER WOULD FLOW FROM THE ELLIOTT WEST CSO CONTROL FACILITY INTO THE ELLIOTT WEST EFFLUENT PIPELINE AND THEN INTO THE ELLIOTT WEST OUTFALL. AFTER THE STORM SUBSIDES FLOWS WILL BE PUMPED TO THE ELLIOTT BAY INTERCEPTOR FOR TREATMENT AT THE WEST POINT TREATMENT PLANT.

ELLIOTT WEST CSO FACILITY

MONTGOMERY WATSON